
NFPA 13 Fire Sprinkler Riser Detail

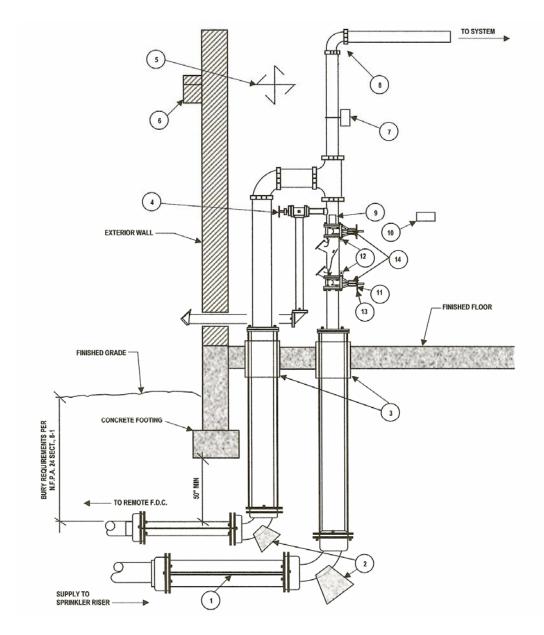

RISER KEY NOTES

- 123456789101121314 5'- 0" DUCTILE IRON STUB-OUT FEED THRUST BLOCK SLEEVE THRU FLOOR 2" MAIN DRAIN WITH ANGLE VALVE 4 - WAY SWAY BRACE **EXTERIOR HORN/STROBE** FLOW SWITCH **GROOVED ELBOW** HYDRAULIC DESIGN DATA PLATE
- SPARE SPRINKLER BOX
- DOUBLE CHECK VALVE ASSY 300 PSI PRESSURE GAUGES
- LISTED SYSTEM CONTROL VALVE WITH TAMPER
- TAMPER SWITCH

NOTES:

- 1. FIRE SPRINKLER SYSTEM TO BE ELECTRONICALLY MONITORED BY U.L. OR F.M. LISTED CENTRAL STATION FOR FLOW, TAMPER AND TROUBLE.
- 2. PROVIDE A 3' 0" CLEARANCE AROUND FIRE SPRINKLER RISER FOR MINIMUM ACCESS.
- 3. ALL VALVES SHALL BE A MAX. OF 7' 0" A.F.F.